

APPROVED	O.G. FIG.	
BY	CLASS	SUBCLASS
DRAFTSMAN		


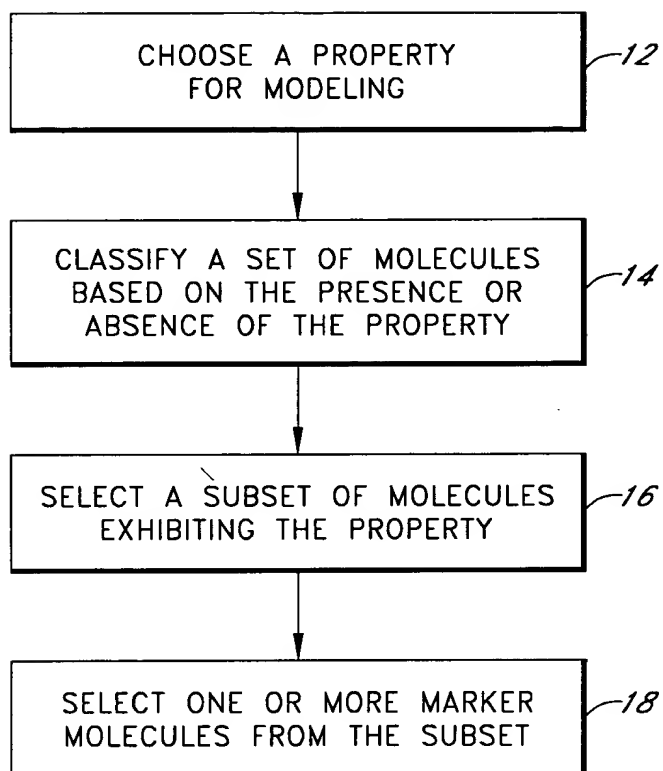


FIG. 1

APPROVED	O.G. FIG.	
BY	CLASS	SUBCLASS
DRAFTSMAN		

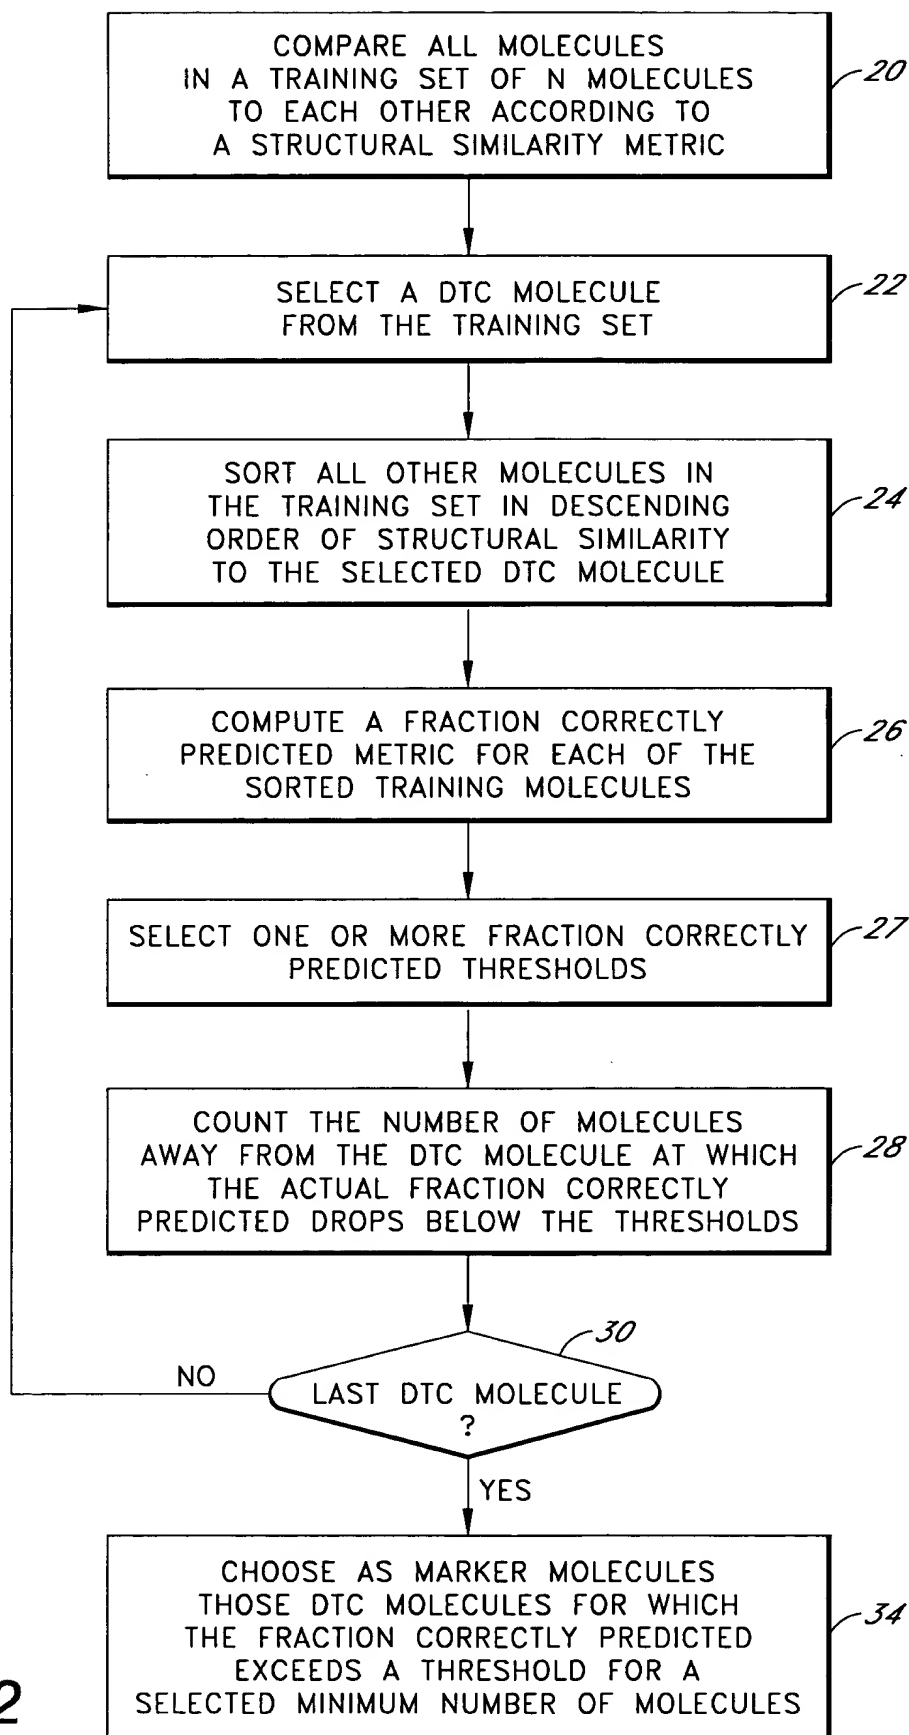

APPROVED	O.G. FIG.	
BY	CLASS	SUBCLASS
DRAFTSMAN		

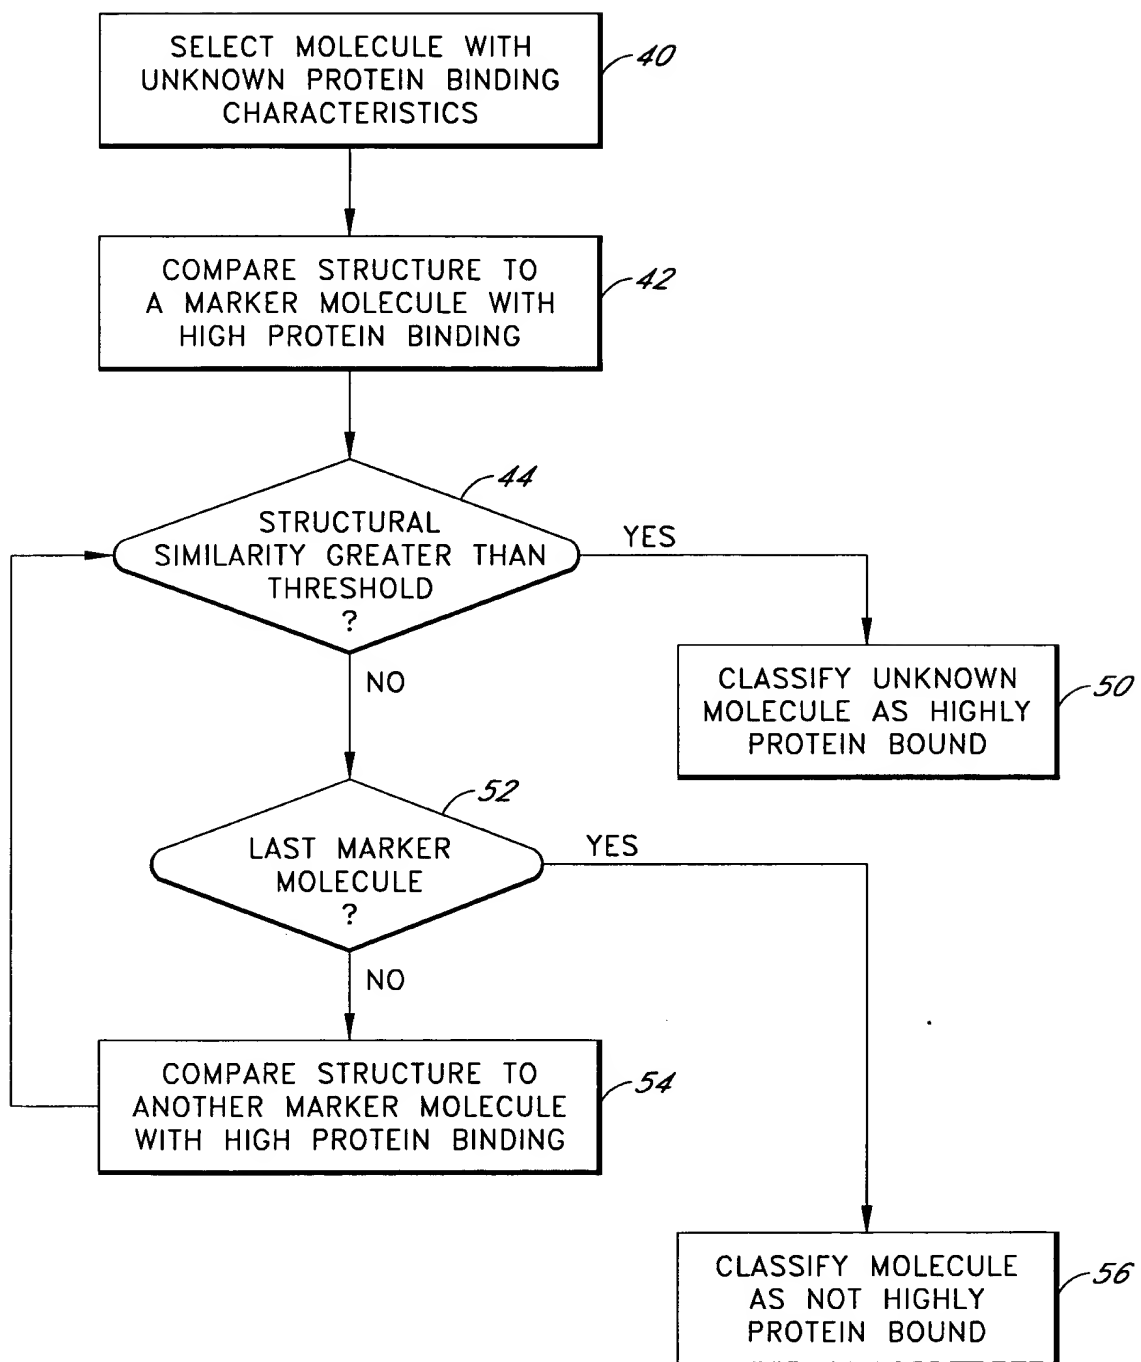


FIG. 3

APPROVED	O.G. FIG.	
BY	CLASS	SUBCLASS
DRAFTSMAN		


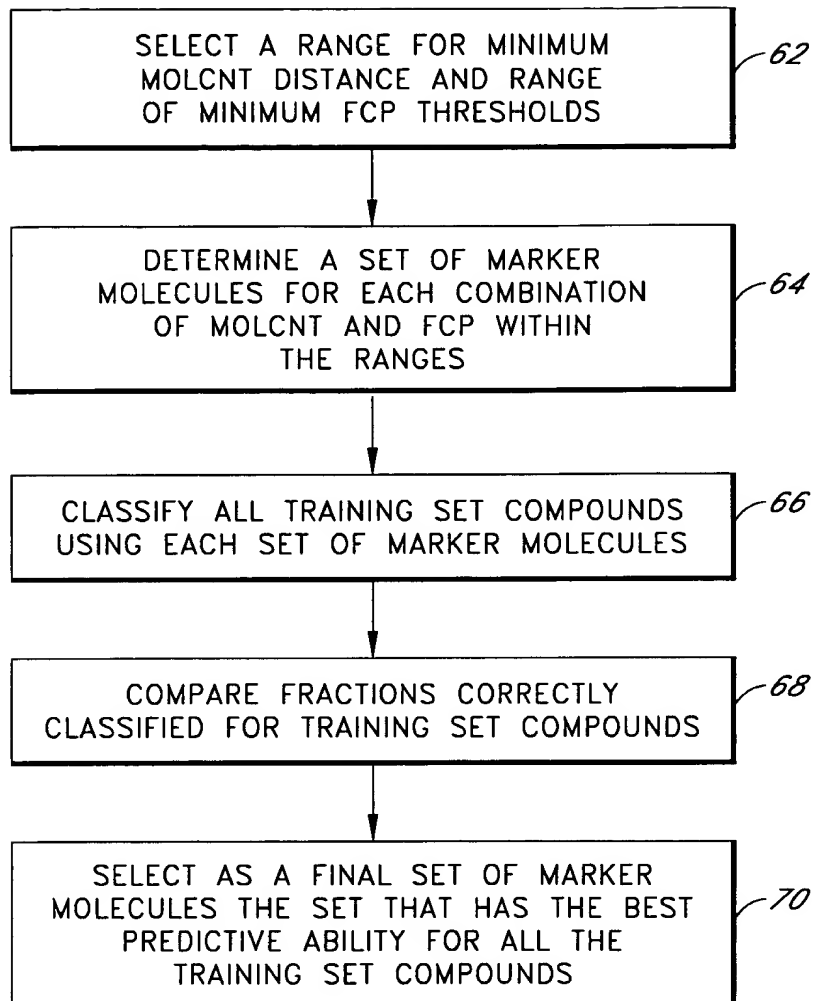


FIG. 4

APPROVED	O.G. FIG.	
BY	CLASS	SUBCLASS
DRAFTSMAN		

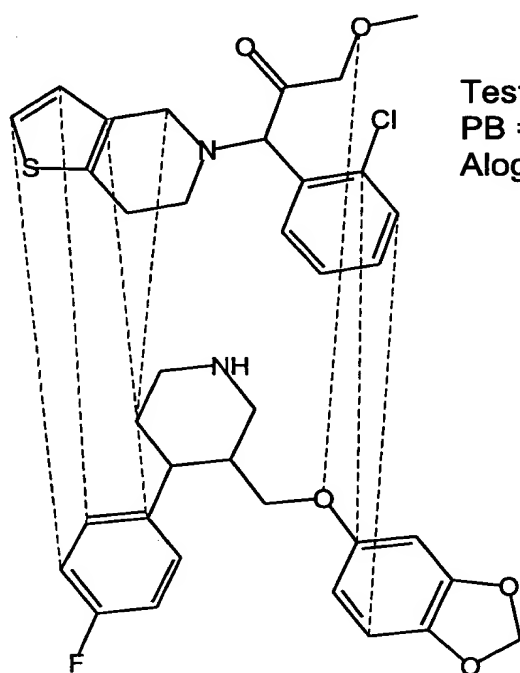

Test Compound: Clopidogrel
 PB = 98%
 AlogP98 = 3.51

Marker: Paroxetine
 PB = 95%
 AlogP98 = 3.56

FIG. 5